



Telephone:0484-2623576
email:-qcdlaluva@gmail.co



KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101
WATER TEST REPORT

ULR NO:TC121192500002493F

Report No: KWA/QCDL-ALY/S/2086/6/25

Report Issue Date: 26.06.2025

Customer Name & Address	Date of Receipt of Payment	12.06.25
	Date of Sample received	17.06.25
	Sample given by	HI, FHC Kuzhur
	Sample Code	ALY/S/2086/6/25
	Sample Name	Drinking Water
	Sample Condition	Good
	Source of Sample	Well
	Sample Quantity	2 Litre
	Test performing dates : From :23.06.25 to 25.06.25	

Sl.No	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Fluoride (as F ⁻)	mg/L	IS 3025 (Part 60/Sec-1)-2023	1	BDL(DL=0.2)
2	Acidity	mg/L	IS 3025 (Part 22)-2024		1.00
3	Electrical conductivity at 25 ^o - C	micromhos/cm	IS 3025 (Part 14)-2013(Reaffirmed 2023)		35.00
4	Colour	HU	IS 3025 (Part 4)-2021	5	1
5	Odour	-	IS 3025 (Part 5)-2018	Agreeable	Agreeable
6	Turbidity	NTU	IS 3025 (Part10)-2023	1.0	BDL(DL=0.1)
7	pH at 25 ^o C	-	IS 3025 (Part 11)-2022)	6.5 to 8.5	8.22
8	Total Alkalinity	mg/L	IS 3025 (Part 23)-2023	200	14.10
9	Sulphate (as SO ₄)	mg/L	IS 3025 (Part 24/Sec-1)-2022	200	BDL(DL=1.00)
10	Total Dissolved Solids (TDS) @180 ^o c	mg/L	IS 3025 (Part 16)-2023	500	20
11	Total Hardness (as CaCO ₃)	mg/L	IS 3025 (Part21)-2009(Reaffirmed 2023)	200	14.00
12	Calcium (as Ca)	mg/L	IS 3025 (Part 40)-2024	75	4.01
13	Magnesium (as Mg)	mg/L	IS 3025 (Part 46)-2023	30	1.00
14	Chloride (as Cl)	mg/L	IS 3025 (Part 32)-1988(Reaffirmed 2019)	250	4.90
15	Iron (as Fe)	mg/L	IS 3025 (Part 53)-2024	1	0.10
16	Nitrate (as NO ₃)	mg/L	APHA 24th Edition-4500-NO ₃ Method B(UV Spectrophotometric Screening Method)	45	BDL(DL=1.00)

Remarks:- DL : Detectable Limit
BDL : Below Detectable Limit

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By Technical Manager


Reviewed By Deputy Quality Manager

Authorized By Quality Manager

End of Report

KWA/QCDL/ALY/01-2020	Issue Date : 04.10.2020
Rev No: 03	Rev,Date : 02/06/2025
Page 2 of 3	

QUALITY MANAGER
KWA, QUALITY CONTROL DISTRICT LAB
ERNAKULAM, ALUVA - 683 101

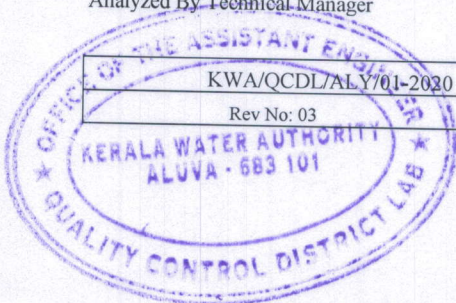



Telephone:0484-2623576
email:-qcdlaluva@gmail.co

KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101
WATER TEST REPORT

Report No: KWA/QCDL-ALY/S/2086/6/25

Report Issue Date: 26.06.2025

Customer Name & Address St Joseph Of Tarbes School Kundoor P O Thrissur	Date of Receipt of Payment	12.06.25
	Date of Sample received	17.06.25
	Sample given by	HI, FHC Kuzhur
	Sample Code	ALY/S/2086/6/25
	Sample Name	Drinking Water
	Sample Condition	Good
	Source of Sample	Well
	Sample Quantity	2 Litre
	Test performing dates : From :23.06.25 to 25.06.25	

SLNo	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500- 2012	Result
1	Residual Chlorine	mg/L	IS 3025 (Part 26)-2021	0.2	BDL(DL=0.2)

Remarks:- DL : Detectable Limit
BDL : Below Detectable Limit


- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By Technical Manager

Reviewed By Deputy Quality Manager

Authorized By Quality Manager

End of Report

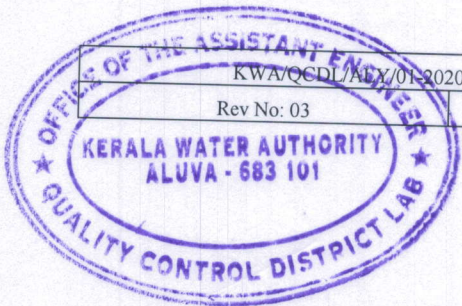

KWA/QCDL/ALY/01/2020	Issue Date : 04.10.2020
Rev No: 03	Page 2 of 3
Rev,Date : 02/06/2025	

QUALITY MANAGER
KWA, QUALITY CONTROL DISTRICT LAB
ERNAKULAM, ALUVA - 683 101



Telephone:0484-2623576
email:-qcdlaluva@gmail.com

KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101

WATER TEST-BACTERIOLOGY REPORT

Report No: ALY/B/8023

Report Issue Date: 26.06.2025

Customer Name & Address		Date of Receipt of Payment	12.06.25	
St Joseph Of Tarbes School Kundoor P O Thrissur		Date of Sample received	17.06.25	
		Sample given by	HI, FHC Kuzhur	
		Sample Code	ALY/B/8023	
		Sample Name	Drinking Water	
		Sample Condition	Good	
		Source of Sample	Well	
		Sample Quantity	250ml	
		Test performing dates :	From :17.06.25 to 18.06.25	
Sl. No.	Parameter	Acceptable Limit as per IS 10500-2012	Test Method	Result
1	Total Coliform	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent
2	E-Coli	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By

Resend P.A
(TM)

End of Report

Authorized By Quality Manager

deers

KWA/QCDL/ALY/01/2020


Issue Date : 04.10.2020

Rev No: 03

Rev,Date : 02/06/2025

Page 3of 3

QUALITY MANAGER
KWA QUALITY CONTROL DISTRICT LAB
ERNAKULAM, ALUVA - 683 101

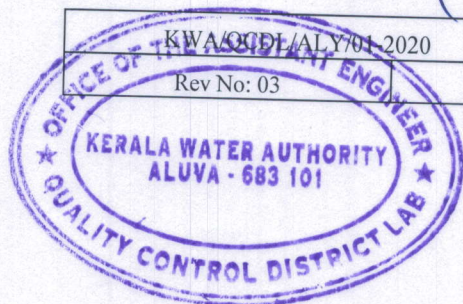

KERALA HEALTH SERVICES DEPARTMENT
FAMILY HEALTH CENTRE KUZHUR- KUZHUR GRAMAPANCHAYATH
Thrissur District, PIN-680734, email ID- kuzhurphc2011@gmail.com

SANITARY FITNESS CERTIFICATE

No. Ph.08/2025

Date: 11/08/2025

This is to certify that Sr. Deepthi Kalappurakkal, Principal, St. Joseph of Tarbes School Kundoor P. O., has provided necessary arrangements for running a CBSE School named St. Joseph of tarbes School Kundoor P. O. in Building No. VIII/321-A, 321-B at Kuzhur Gramapanchayath.

This certificate is issued as per application from Sr. Deepthi Kalappurakkal, Principal, St. Joseph of Tarbes School Kundoor P. O. to renewing of approval. This certificate is liable to be cancelled if the Sanitary and Healthy conditions found unsatisfactory during inspection. This certificate is issued with the following conditions.

- 1) Statutory sign board as per COTPA-2003 should be exhibited.
- 2) Waste and waste water materials must be segregated and disposed as per rules.
- 3) Name board should be displayed.
- 4) Details of migrant labours to be submitted to the Family Health Centre Kuzhur.
- 5) There should not be any nuisance, public health problems.
- 6) Infectious diseases and notified infectious diseases if any, suspects or confirmed should be immediately reported to the undersigned.



Signature of Issuing Authority


പൊതുജനാരോഗ്യ ഉപതലവൻ
കുടുംബാരോഗ്യ കേന്ദ്രം
കുടുംബാരോഗ്യ കേന്ദ്രം, തൃശ്ശൂർ ജില്ല